

GOVERNMENT DEGREE COLLEGE NARSAMPET

WARANGAL DISTRICT (RURAL) 506132 TELANGANA STATEwgl.jkc.nspt@gmail.com; Mob.9849551559



website:https://www.gdcts.cgg.gov.in/narsampet.edu

7.1.4 Water Harvesting Pits.

Water harvesting / recharging pit was dug near the Hand pump date:-02-09-2021.



Water harvesting / Recharging pit was dug near the Hand pump. Date:-02-09-2021.




Rain Water harvesting / Recharging pit was dug near the Drinking Water taps. Date:-02-09-2021.




Over Head Water tank on the Girls Toilets Block I & II in the College to uninterrupted Water supply to the toilets

Date:-04-09-2021.

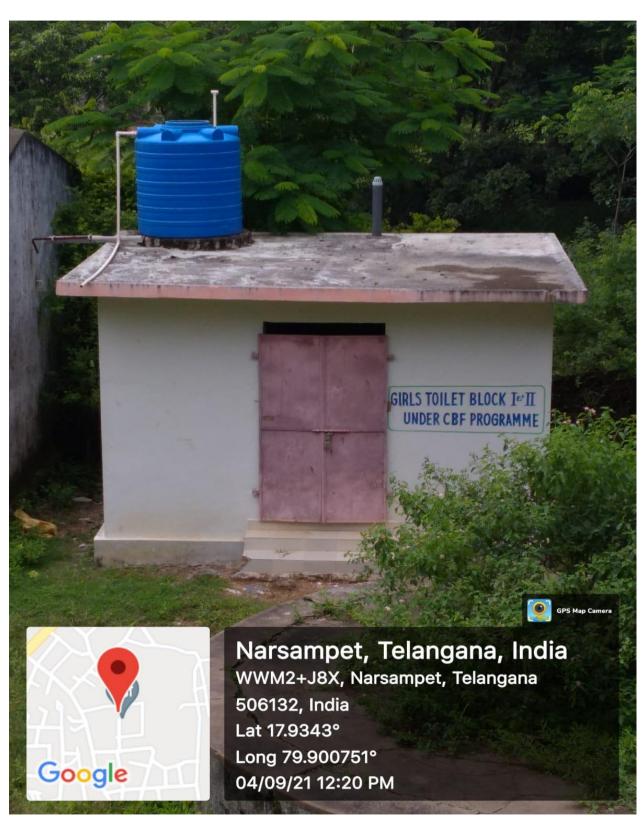

Over Head Tank on the College Roof for the Drinking Water & Gardening purpose in the college. Date:- 04-09-2021.

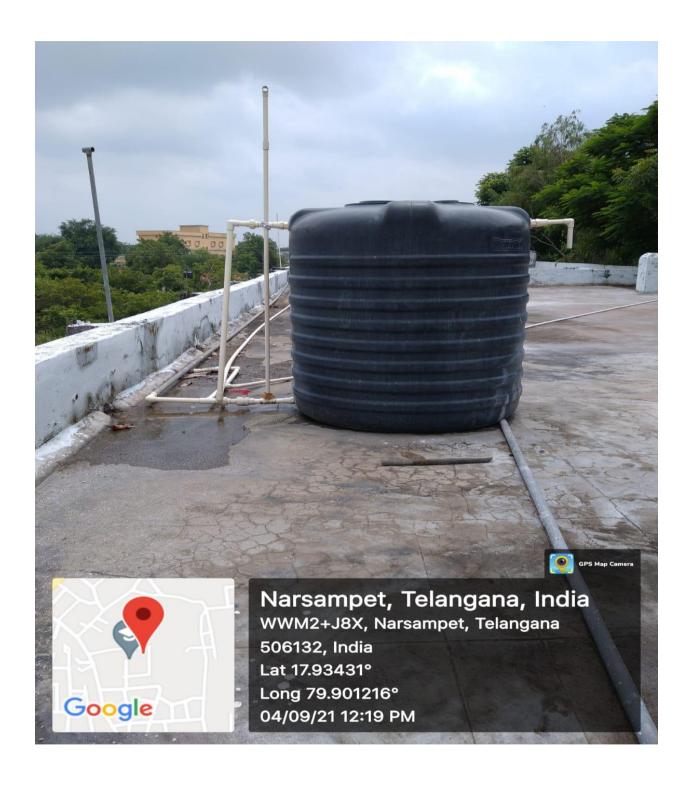






Newly Installed Over Head Tank on the Principals Chamber Roof for the water supply to the Principals Office & Haritha Haram Plants.


Date: 03-09-2021.

Rain Water Harvesting Pits in College premises, due to which ground water level increased. Date:- 03-09-2021.




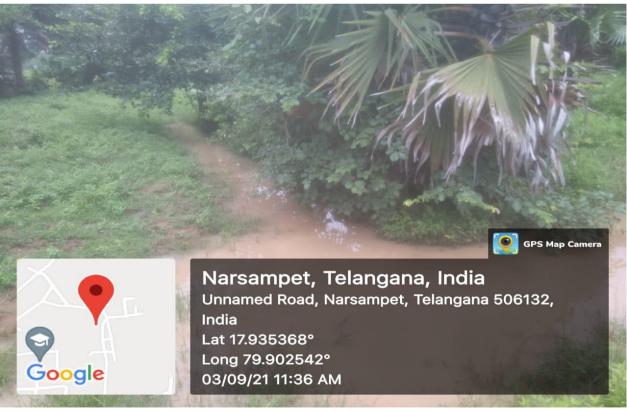

Rain Water Harvesting Pits in College premises, due to which ground water level increased. Date:- 03-09-2021.

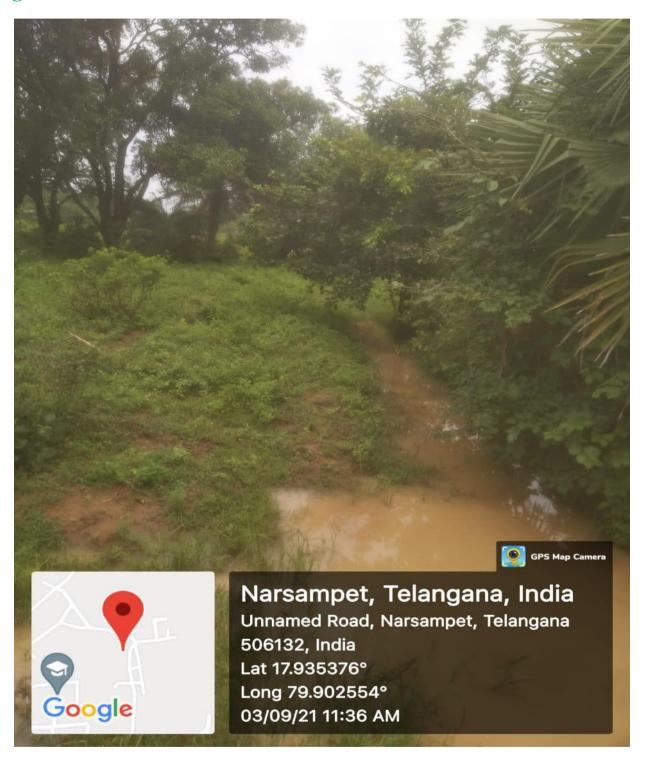

Rain Water Harvesting Pits in College premises, due to which ground water level increased. Date:- 03-09-2021.

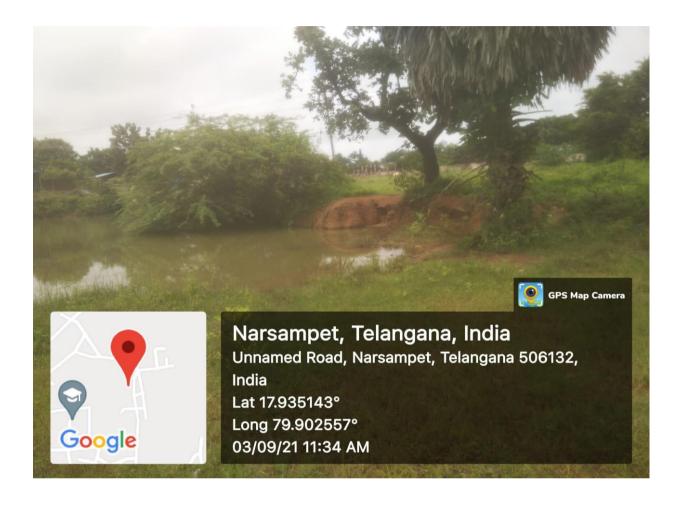

Water Distribution System in the College Campus

Date:-03-09-2021.






Pipe line System for the Supply of Water from the Over Head Tanks to Botany, Zoology and Chemistry Laboratories, R.O. Plant & Washrooms Date:-08-09-2021.





Open Well

Date:-03-09-2021.

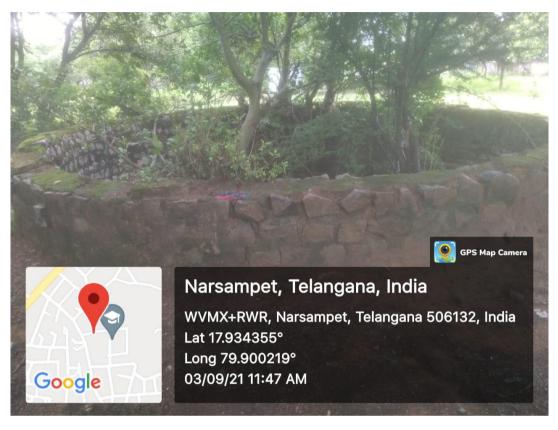





GOVERNMENT DEGREE COLLEGE NARSAMPET


WARANGAL DISTRICT (RUKAL) 664132 TELANGAHA STATE


wst/sc.martigmot.com Mob.9849551559 website https://www.gdcts.cgg.gdv.iti/norsampet.edu




7.1.4 Water conservation facilities available in the institution.

Construction of Water Soaking Pits inside the Collage Campus

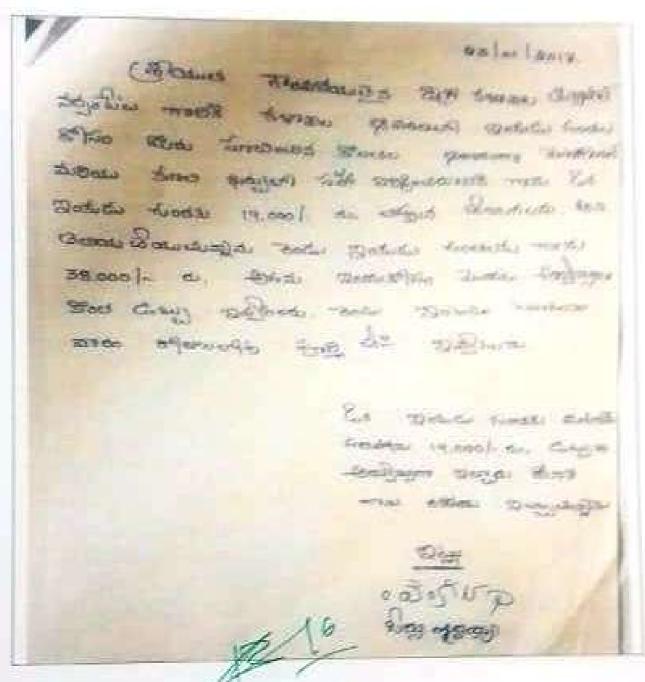





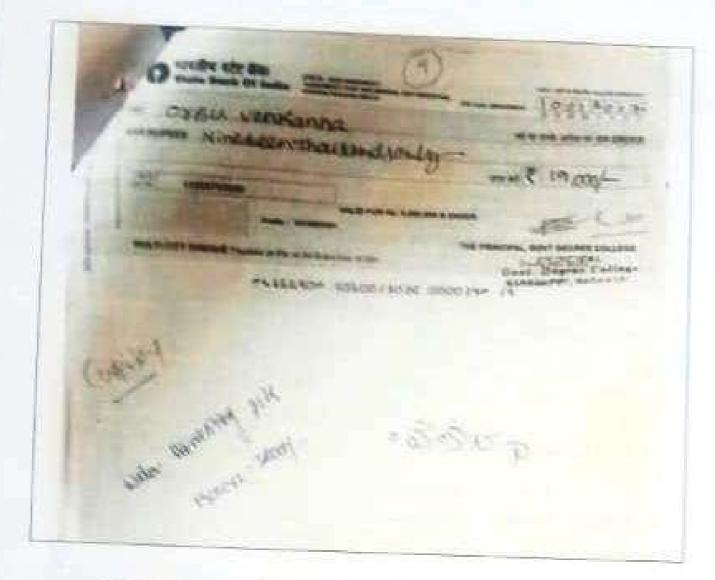

This is to certify that two water soaking pits dug inside the campus, one is at the hand pump and the other one is at drinking water plant. This was capitalized in the year of 2017-18.

Togree Com

32579008190-806 FT

